


# Multi-Pure's Superior Performance Confirmed by Testing and Certification

The effectiveness of any drinking water treatment device is measured by the performance of its filter. NSF testing in accordance with NSF/ANSI standards provides the consumer with the highest level of assurance that certified products will perform as claimed. A close review of NSF Listings shows that Multi-Pure's solid carbon block filters are the most effective for reducing a broad spectrum of contaminants of aesthetic as well as health concern.


## NSF Listings by Standard

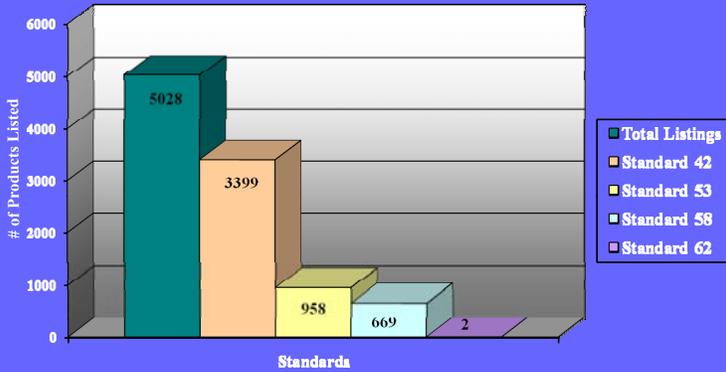

NSF Online Listings  
March 26, 2009

### Chart A


## NSF Listings by Single Contaminant

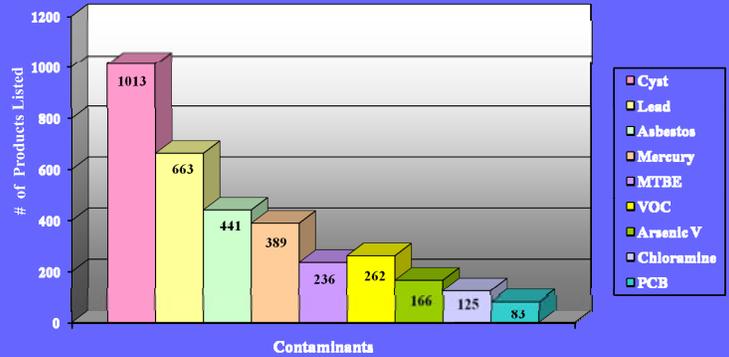

NSF Online Listings  
March 26, 2009

### Chart B


## Listings by Combinations of Contaminants

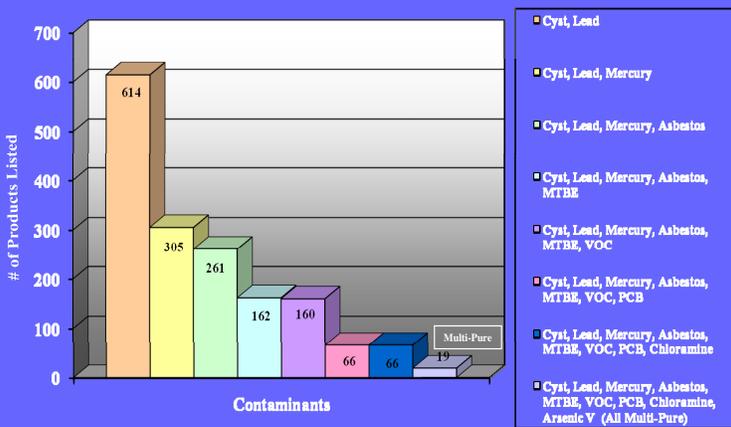

NSF Online Listings  
March 26, 2009

### Chart C

## Manufacturers by Combinations of Contaminants

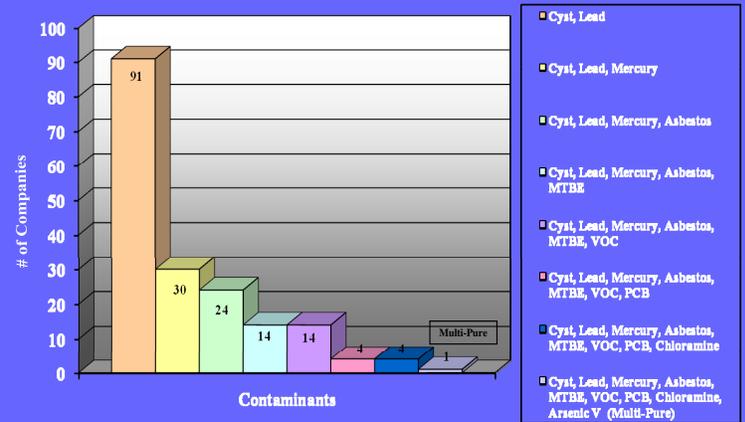

NSF Online Listings  
March 26, 2009

### Chart D

# Comparing Drinking Water Systems Certified Performance Says It All

Testing programs and standards developed by NSF International provide a basis for evaluating and comparing drinking water treatment units. Although thousands of drinking water systems have been tested and certified, only a few are certified to reduce a wide range of contaminants. These charts summarize NSF Listings by standard, by single contaminants, and by combinations of contaminants.

Only Multi-Pure Drinking Water Systems are certified to reduce Lead, Mercury, Cyst, Asbestos, VOC, MTBE, PCB, Chloramine, and Arsenic V. By carefully reviewing the certification of a product, consumers can make an informed decision about the drinking water treatment device that will provide the performance they need.

## NSF Listings by Standard - Chart A

By Standard	Products
Aesthetics, Standard 42	3399
Health Effects, Standard 53	958
Reverse Osmosis, Standard 58	669
Distillation, Standard 62	2
<b>Total</b>	<b>5028</b>

## NSF Listings by Contaminant - Chart B

By Single Contaminants	Number of Products			
	Health Effects	Reverse Osmosis	Distillers	Total
PCB	83	0	0	83
Chloramine	125	0	0	125
Arsenic	20	144	2	166
MTBE	236	0	0	236
VOC	258	4	0	262
Mercury	388	0	1	389
Asbestos	410	31	0	441
Lead	503	158	2	663
Cyst	855	158	0	1013
Chlorine	1674	0	0	1674

## NSF Listings by Combinations of Contaminants - Chart C

By Combination of Contaminants	Number of Products			
	Health Effects	Reverse Osmosis	Distillers	Total
Cyst, Lead	461	153	0	614
Cyst, Lead, Mercury	305	0	0	305
Cyst, Lead, Mercury, Asbestos	261	0	0	261
Cyst, Lead, Mercury, Asbestos, MTBE	162	0	0	162
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	160	0	0	160
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	66	0	0	66
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	66	0	0	66
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramines, <b>Arsenic V</b>	19	0	0	19


All 19 models  
Multi-Pure

## NSF Listings by Manufacturers by Combinations of Contaminants - Chart D

By Combination of Contaminants	Number of Companies			
	Health Effects	Reverse Osmosis	Distillers	Total
Cyst, Lead	52	39	0	91
Cyst, Lead, Mercury	30	0	0	30
Cyst, Lead, Mercury, Asbestos	24	0	0	24
Cyst, Lead, Mercury, Asbestos, MTBE	14	0	0	14
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	14	0	0	14
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	4	0	0	4
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	4	0	0	4
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramines, <b>Arsenic V</b>	1	0	0	1

Multi-Pure

Charts are based on NSF online listings on March 26, 2009  
For more information, go to NSF International website: [www.nsf.org](http://www.nsf.org)



**Multi-Pure Drinking Water Systems**  
The Las Vegas Technology Center  
7251 Cathedral Rock Drive  
Las Vegas, NV 89128  
800-622-9206  
[www.multipure.com](http://www.multipure.com)